

## Features

- Clean Dead-front Construction
- Digitally Recorded Automatic Evacuation Message (Up to 20 Minutes of Message Capacity)
- 25 Watt Bullet-Proof Amplifier
- 25 or 70 VRMS Field Selectable
- Class A/B Speaker Circuit
- 120 VAC Power Supply and Battery Charger
- Live Microphone Override of Message and Tone
- Analog Addressable Compatible
- High Reliability, No Maintenance, Fully Supervised
- Easy Installation and Operation
- Studio Quality Voice Recordings
- Built in Alarm and Alert Signals
- Works with 12 VDC or 24 VDC Fire Alarm Panels
- Works with Microprocessor based and Network Fire Alarm Systems
- 3 Minute Message Restart on Microphone Key
- 24 Hour Backup with 12V 7AH Batteries
- Made in the USA



6911-0328:0219

## Description

The PVX-25 operates with any Fire Alarm Control Panel (FACP) and provides 25 Watts of speaker power. The PVX-25 has its own power supply and battery charger. The Panel must be wired with 120 VAC and standby batteries connected. The PVX-25 is housed in a surface or semi-flush mounted backbox with a hinged and key locked door.

A digital message repeater (DMR) is built into the PVX-25. The selector of alarm tone and automatic message repeats, as well as the 6 hour delay of the AC power failure reporting feature, is all field configurable.


The paging microphone is an integral component. Removal of the microphone from the panel will cause a “Trouble” condition which will be reported locally, as well as through the FACP.

The PVX-25 includes all necessary features to provide an effective voice evacuation system. With the addition of zone splitters, selection switches/inputs, remote microphone panels, and expander modules, the PVX-25 can be custom configured to satisfy the needs of most applications.

## Technical Specifications

Primary Power	120VAC @1.4A
24VDC Battery Power	0.18A Standby 1.1A Alarm
Output	25 Watts @ 25/70 VRMS
Backbox Dimensions (WxHxD)	14.5 x 18 x 4”
Color	Red (standard) Charcoal Grey (optional)

## Typical Installation

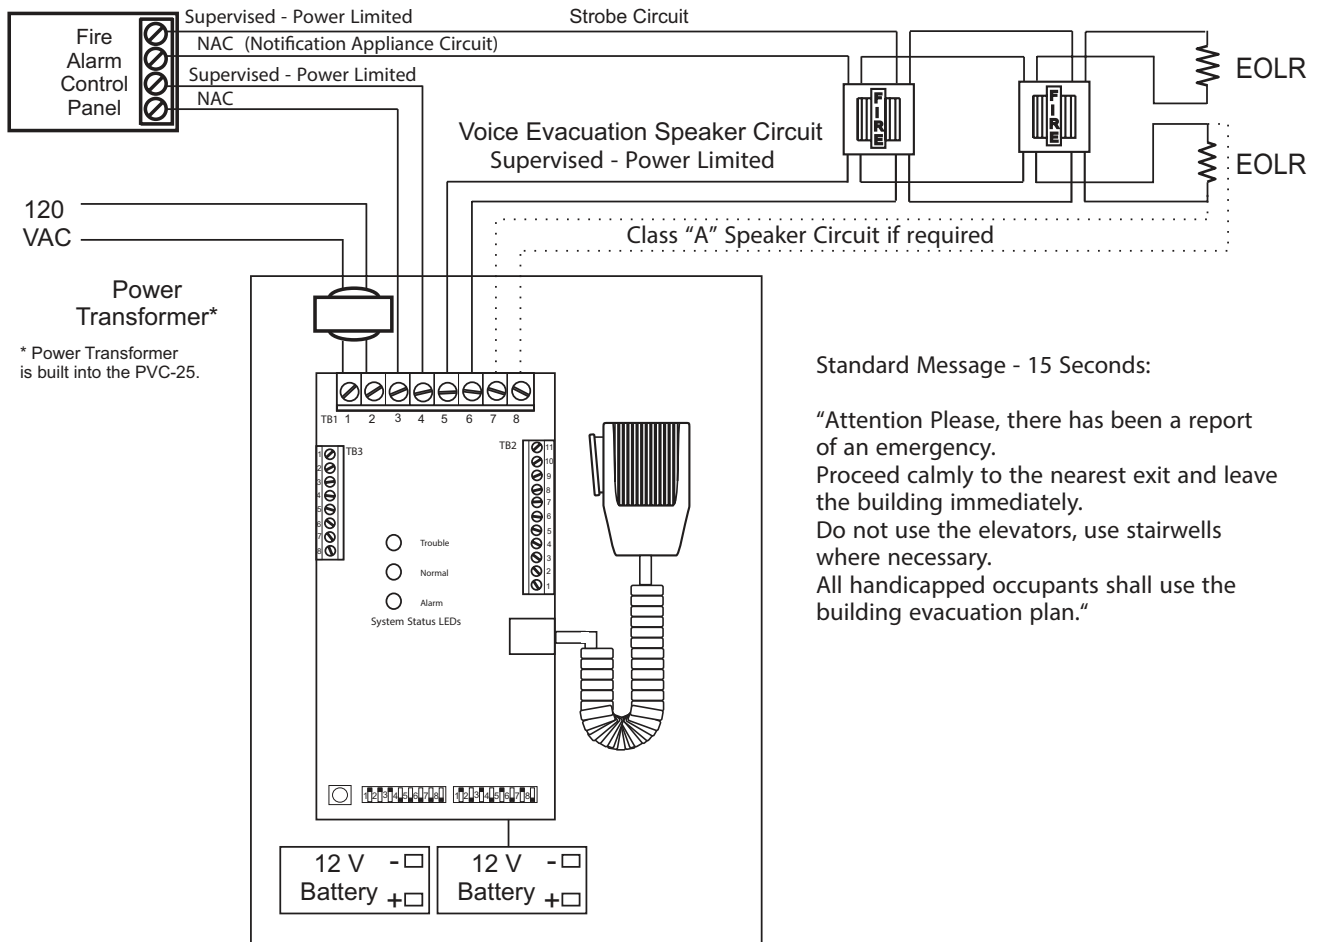

## Engineering Specifications

The voice evacuation system shall be Potter PVX-25 or approved equal. The voice evacuation system shall provide 25 watts signal power and 25 watts voice power, and shall be UL listed. The voice evacuation shall be micro-processor based, and shall contain an integral microphone, 25W audio amplifier, tone generator, digital message repeater, 120VAC power supply and battery charger.

The voice evacuation message/signal shall be broadcast until the Fire Alarm Control Panel (FACP) is reset, or until fire emergency personnel interrupt the broadcast with a manual page. On reset system shall automatically return to standby (normal operating) condition. A secondary message shall be provided which can be triggered by the closure of a contact from either the FACP or from any normally open contact device. Remote paging microphone(s) will be supported by the system through a supervised circuit. Remote microphone(s) may be mounted up to 5000 feet away from the voice evacuation panel.

## Ordering Information

Model Number	Stock Number	Description
PVX-25/4Z	3500001	25W Voice Evacuation System with: <ul style="list-style-type: none"> <li>Power Supply / Battery Charger</li> <li>Paging Microphone</li> <li>Digital Message Repeater</li> <li>4 Speaker Zones</li> </ul>

## Optional Components

- PVX-ZM Zone Module 4-Class B / 2-Class A Circuits
- PVX-SL8 8 Switch/LED Card
- PVX-IL8 8 Input/LED Card
- PVX-OL8 8 Output/LED Card
- PVX-RM / SC Remote MIC / Supervisory Card