



SILENT KNIGHT

by Honeywell

EVS-VCM Voice Control Module Installation Instructions

The EVS-VCM Voice Control Module is contained within the Silent Knight EVS Series panel enclosure. It provides a supervised microphone for live communication and an interface for the Emergency Voice System.

Note: Installation and wiring of this device must be done in accordance with NFPA 72 and local ordinances.

Compatibility

The EVS-VCM is compatible with the IntelliKnight 5820XL-EVS. For programming and addressing, refer to Installation manual for 5820XL-EVS (PN LS10061-001SK-E).

Board Layout & Mounting

1. Open the cabinet door and the dead front panel.
2. Remove AC power and disconnect the backup batteries from the main control panel.

Mount the EVS-VCM in the middle section of the dead front on the six mounting studs. See Figure 1.

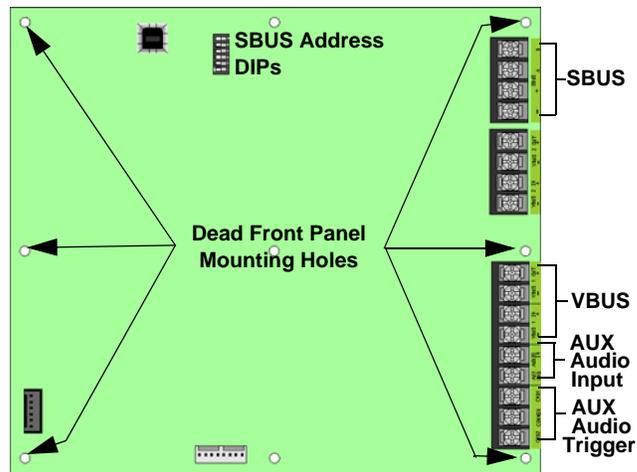


Figure 1: Back View of EVS-VCM

Specifications

Standby Current: 60 mA

Alarm Current: 80 mA

Wiring to a FACP

See Figure 2 to properly wire the EVS-VCM to the FACP SBUS.

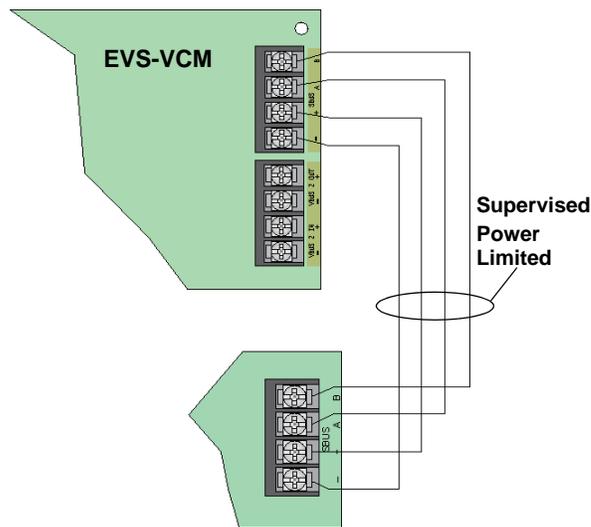


Figure 2: Wiring the EVS-VCM to the FACP

Installing the Microphone

To install the microphone:

1. Clip the microphone into the microphone clip. See Figure 3.

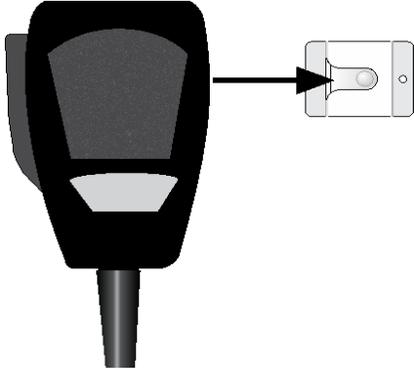


Figure 3: Sliding Microphone into Microphone Clip

2. Insert microphone cord through hole at the bottom of the dead front panel. See Figure 4.

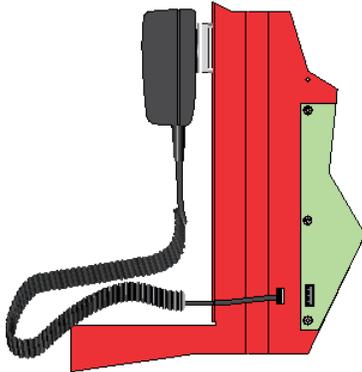


Figure 4: Microphone Cord Inserted Through Dead Front Panel Hole

3. Attach strain relief clip to microphone cord. The strain relief clip should have about 2¾" of microphone cord through it.

See Figure 5.

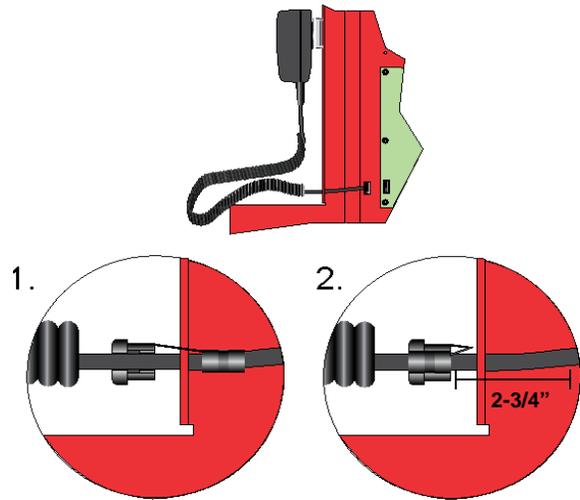


Figure 5: Installing Strain Relief Clip

4. Push the strain into the hole in the dead front panel.
5. Restore AC power and reconnect the backup batteries.



12 Clintonville Road
Northford, CT 06472-1610 USA
203-484-7161
Fax: 203-484-7118
www.silentknight.com

© 2013 Honeywell International Inc.