



TECHNICAL DATA

FOAM RATIO CONTROLLER MODEL VRC

The Viking Corporation, 210 N Industrial Park Drive, Hastings MI 49058

Telephone: 269-945-9501 Technical Services: 877-384-5464 Fax: 269-818-1680 Email: techsvcs@vikingcorp.com

Visit the Viking website for the latest edition of this technical data page www.vikinggroupinc.com

1. GENERAL DESCRIPTION

The ratio controller accurately proportions foam concentrate into a water stream over a wide range of water flow rates. Ratio controllers are an integral part of an approved foam system. In addition to the ratio controller, the main components of the approved foam system are specific foam concentrates, a foam storage tank, a concentrate control valve and foam discharge devices.

The system must be designed so that the ratio controller can accurately proportion foam over the range of flow rates expected during the system operation.

Intended for use in Wet, Dry, Deluge, Preaction and Refrigerated Area applications. Please refer to specific system manual(s) for further information. This technical data is intended for trained experts. For further information, please contact the appropriate sales office in Section 5 or refer to the technical documentation.

The contents of this publication are subject to modifications without notice.

2. LISTINGS AND APPROVALS

The ratio controller is FM Approved and UL Listed as part of a fire extinguishing system combining designated foam concentrates, bladder tanks and discharge devices. Approved and Listed system components can be found at www.approvalguide.com and <https://iq.ulprospector.com>



FM Approved – Low Expansion Foam Systems (FM5130)



UL Listed – GFGV.EX27255, GHXV.EX5002, GLKX.EX27844 (UL162)



Certificated by the Academy of the State Fire Service of the Ministry of Emergency Situations of Russia. 123FL (Russia)

“SFFF compatible” refers to this product as being part of a SFFF Foam system that has been tested to recognized standards. Not all configurations are available. Please consult technical data and/or the Approval/Listing for usage requirements.

Other International approval certificates may be available upon request.

3. TECHNICAL DATA

3.1 Construction Features

- Available Grooved with 2” (DN50), 2.5” (DN65), 3” (DN80), 4” (DN100), 6” (DN150), 8” (DN200) connections and Flanged with 3” (DN80), 4” (DN100), 6” (DN150), 8” (DN200) connections
- Brass construction (Grooved only) or Nickel Aluminium Bronze construction for superior corrosion protection
- Horizontal or Vertical Installation
- Direction of flow indicator on body
- For use with Fresh or Salt Water
- Identification tag plate



Images are for illustration purposes only. Refer to drawings for actual design details.



WARNING: Cancer and Reproductive Harm-
www.P65Warnings.ca.gov





TECHNICAL DATA

FOAM RATIO CONTROLLER MODEL VRC

The Viking Corporation, 210 N Industrial Park Drive, Hastings MI 49058
 Telephone: 269-945-9501 Technical Services: 877-384-5464 Fax: 269-818-1680 Email: techsvcs@vikingcorp.com
 Visit the Viking website for the latest edition of this technical data page www.vikinggroupinc.com

3.2 Standard Materials

Table 3.2.1 - Standard Materials	
Nickel Aluminum Bronze Version (Grooved and Flanged connections)	
Body & Nozzle	Nickel Aluminum Bronze UNS C95800 – ASTM B148
Orifice	UNS-C36000 or C46400 or C95800
Snap Ring	Stainless Steel
Brass Version (Grooved only)	
Body & Nozzle	Cast Brass UNS C84400 – ASTM B584
Orifice	Brass UNS C36000
Snap Ring	Stainless Steel
See notes in Table 3.4.1 for ordering information	

3.3 Standard Design Specifications

Table 3.3.1 - Standard Design Specifications	
All Versions	
Design Pressure	250 PSI / 17.2 bar (1.7MPa)
Design Temperature Range	14F to 120F (-10C to 49C)
Operating Temperature Range	35F to 120F (1.7C to 49C)
Minimum Operating Inlet Pressure	30 PSI / 2.1 bar (0.2MPa)
Maximum Operating Inlet Pressure	175 PSI / 12.1 bar (1.2MPa)
Proportioning Range	Refer to Table 3.4.1 or 3.4.2

3.4 Ordering Information

- Select connection type Grooved (Table 3.4.1) or Flanged (Table 3.4.2).
Note: Take care in selecting the correct part number due to different connection styles (different grooved outside diameters, flanges and threads)
- Select the Foam Concentrate Type in table 3.4.1 or 3.4.2
- The minimum and maximum flow demand of the sprinkler/deluge system must be known to ensure correct selection of the ratio controller. The required minimum flow rate should be higher than the minimum flow rate shown in table 3.4.1 or 3.4.2 for the Foam Type selected in Step 2). The required higher flow rate should be lower than the maximum flow rate shown in table 3.4.1 or 3.4.2. If more than one size of ratio controller is suitable then size selection can then be based on the size of the riser or supply pipework into which the ratio controller will be installed.
Note: The flow rates in the FM Approval and UL Listing sometimes differ. Please check the flow range data in table 3.4.1 or 3.4.2 according to the FM Approval or UL Listing.
- After selecting the size, check the appropriate graph in section 7.2.1 to ensure the required flows are possible at the available system pressure. If not, it may be necessary to increase to the next pipe size.
Note: Grooved Nickel Aluminium Bronze Ratio Controllers are standard for EMEA and Asia sales regions and Brass is standard for the Americas. Flanged Ratio Controllers are only available in Nickel Aluminium Bronze.



TECHNICAL DATA

FOAM RATIO CONTROLLER MODEL VRC

The Viking Corporation, 210 N Industrial Park Drive, Hastings MI 49058
 Telephone: 269-945-9501 Technical Services: 877-384-5464 Fax: 269-818-1680 Email: techsvcs@vikingcorp.com
 Visit the Viking website for the latest edition of this technical data page www.vikinggroupinc.com

Table 3.4.1 - Ordering information (Grooved Connection)

Connection		Foam Type ⁵	Part Number		Foam Inlet Orifice Size		FM Approved				UL Listed			
Body Grooved	Foam Inlet Grooved		Nickel Aluminium Bronze ^{2,4}	Brass ³	Inch	mm	Minimum Flow Rate ¹		Maximum Flow Rate ¹		Minimum Flow Rate		Maximum Flow Rate	
							GPM	L/min	GPM	L/min	GPM	L/min	GPM	L/min
3" (88,9mm)	1.5" (48,3mm)	3% XMAX	VRC089JAN	F20152N	0.362	9.19	N/A	N/A	N/A	N/A	50	189	740	2801
4" (114,3mm)	2" (60,3mm)	3% XMAX	VRC114JAN	F20217N	0.485	12.32	N/A	N/A	N/A	N/A	46	174	1600	6057
6" (165,1mm)	2" (60,3mm)	3% XMAX	VRC165JAN	N/A	0.700	17.78	N/A	N/A	N/A	N/A	99	375	3050	11546
6" (168,3mm)	2" (60,3mm)	3% XMAX	VRC168JAN	F20214N	0.700	17.78	N/A	N/A	N/A	N/A	99	375	3050	11546
8" (219,1mm)	2.5" (76,1mm)	3% XMAX	VRC2196JAN	N/A	0.975	24.77	N/A	N/A	N/A	N/A	242	946	4942	19305
8" (219,1mm)	2.5" (73,0mm)	3% XMAX	VRC2193JAN	F20137N	0.975	24.77	N/A	N/A	N/A	N/A	242	946	4942	19305

NOTES:

- ¹ Please refer to graphs in section 7.2 for specific flow rate parameters.
- ² Nickel Aluminium Bronze (NAB) - Standard Offering in Viking EMEA & APAC Territories. Brass available on request with longer delivery.
- ³ Brass - Standard Offering in Viking Americas Territories. Nickel Aluminium Bronze available on request with longer delivery.
- ⁴ NAB 73mm and NAB 219mm with 73mm foam inlet are non standard and could be subject to additional lead time and price.
- ⁵ Relevant foam types comply with the requirements of the EPA 2010/2015 PFOA Stewardship Program.

Table 3.4.2 - Ordering information (Flanged Connection)

Connection		Foam Type ⁴	Part Number ²		Foam Inlet Orifice Size		FM Approved				UL Listed			
Body Flanged ³	Foam Inlet Threaded		ANSI	PN16	Inch	mm	Minimum Flow Rate ¹		Maximum Flow Rate ¹		Minimum Flow Rate ¹		Maximum Flow Rate ¹	
							GPM	l/min	GPM	l/min	GPM	l/min	GPM	l/min
3" (DN80)	1.5" NPT (ANSI) or BSP (PN16) Thread	3% XMAX	VRC080JAN	VRC080PJAN	0.362	9.96	N/A	N/A	N/A	N/A	50	186	740	2801
4" (DN100)	2" NPT (ANSI) or BSP (PN16) Thread	3% XMAX	VRC100AJAN	VRC100PJAN	0.485	12.32	N/A	N/A	N/A	N/A	46	174	1600	6057
6" (DN150)	2" NPT (ANSI) or BSP (PN16) Thread	3% XMAX	VRC150AJAN	VRC150PJAN	0.700	17.78	N/A	N/A	N/A	N/A	99	375	3050	11546
8" (DN200)	2.5" NPT (ANSI) or BSP (PN16) Thread	3% XMAX	VRC200AJAN	VRC200PJAN	0.975	24.77	N/A	N/A	N/A	N/A	242	946	4942	19305

NOTES:

- ¹ Please refer to graphs in section 7.2 for specific flow rate parameters.
- ² Flanged ratio controller not available in Brass - Nickel Aluminium Bronze only.
- ³ ANSI and PN16 flanges with Flat Face (FF) only.
- ⁴ Relevant foam types comply with the requirements of the EPA 2010/2015 PFOA Stewardship Program.

INFORMATION

Some of the available options may be not covered by the UL Listing. Please always make reference to the appropriate approval directory or guides or contact Viking for further assistance.



TECHNICAL DATA

FOAM RATIO CONTROLLER MODEL VRC

The Viking Corporation, 210 N Industrial Park Drive, Hastings MI 49058

Telephone: 269-945-9501 Technical Services: 877-384-5464 Fax: 269-818-1680 Email: techsvcs@vikingcorp.com

Visit the Viking website for the latest edition of this technical data page www.vikinggroupinc.com

4. SCOPE OF DELIVERY

Ensure that all components are complete and in good condition. The ratio controller is supplied boxed, with data plate and an integral sized orifice disc specific to its approved/listed concentrate. Grooved couplings are not included.

5. AVAILABILITY

The product is available directly from Viking and official distributors only.

Americas:

The Viking Corporation
5150 Beltway SE
Caledonia, MI 49316
Tel.: (800) 968-9501
Fax: 269-818-1680
Technical Services: 1-877-384-5464
techsvcs@vikingcorp.com

EU:

Viking S.A.
21, Z.I, Haneboesch
L-4562 Differdange / Nieder Korn
Tel.: +352 58 37 37 - 1
Fax: +352 58 37 36
vikinglux@viking-emea.com

Asia Pacific (APAC) Main Office:

The Viking Corporation (Far East) Pte. Ltd.
69 Tuas View Square
Westlink Techpark, Singapore 637621
Tel: (+65) 6 278 4061
Fax: (+65) 6 278 4609
vikingAPAC@vikingcorp.com

6. PRODUCT VARIANTS

6.1 Options

- Suitable for Viking Foam Concentrates: 3% XMAX.
- Nickel Aluminum Bronze UNS C95800 or Brass UNS C84400 (see table 3.4.1)
- Pre-Assembled with Bladder Tank and water/foam pipe work

6.2 Dimensions and Equivalent Length

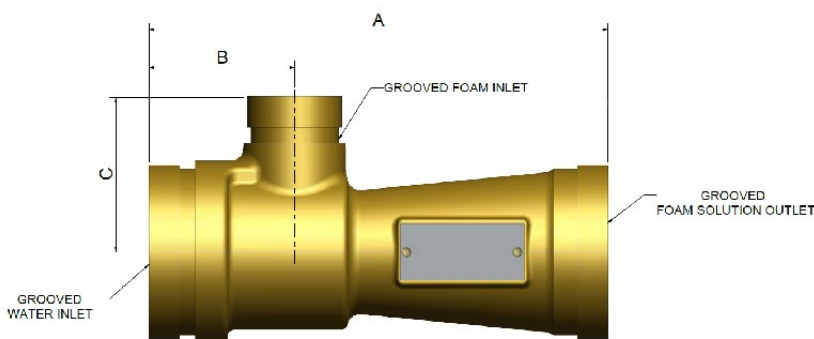


Figure 6.2.1 Model VRC Ratio Controller (Grooved)

Table 6.2.2 - Equivalent Length, Weight & Dimension Data

Nominal Size	Equivalent Length (friction loss)*		Approximate Weight				Approximate Dimensions							
			NAB Version		Brass Version		A		B		C		Grooved Foam Inlet	
	Feet	Metre	LBS	KGs	LBS	KGs	Inch	mm	Inch	mm	Inch	mm	Inch	mm
2" (DN50) Grooved	46	14.02	4.9	2.2	6.5	3.0	8-1/4	210	3	76	2-9/16	65	1.5	48.3
2.5" (DN65) Grooved	39	11.89	6.0	2.7	7.5	3.4	8-3/4	222	2-15/16	75	2-13/16	71	1.5	48.3
3" (DN80) Grooved	31	9.45	8.6	3.9	11.0	5.0	9-1/4	235	2-15/16	79	3-1/8	79	1.5	48.3
4" (DN100) Grooved	37	11.28	13.9	6.3	25.0	11.3	11	279	3-5/16	84	3-9/16	91	2	60.3
6" (DN150) Grooved	88	26.82	30.6	13.9	37.0	16.8	15	381	3-5/16	84	4-5/8	118	2	60.3
8" (DN200) Grooved	114	34.75	51.8	23.5	63.0	28.5	16-3/4	426	3-11/16	94	5-5/8	143	2.5	76.1
8" (DN200) Grooved	114	34.75	51.8	23.5	63.0	28.5	16-3/4	426	3-11/16	94	5-5/8	143	2.5	73.0

* Expressed in equivalent length of schedule 40 pipe based on Hazen & Williams C=120



TECHNICAL DATA

FOAM RATIO CONTROLLER MODEL VRC

The Viking Corporation, 210 N Industrial Park Drive, Hastings MI 49058
 Telephone: 269-945-9501 Technical Services: 877-384-5464 Fax: 269-818-1680 Email: techsvcs@vikingcorp.com
 Visit the Viking website for the latest edition of this technical data page www.vikinggroupinc.com

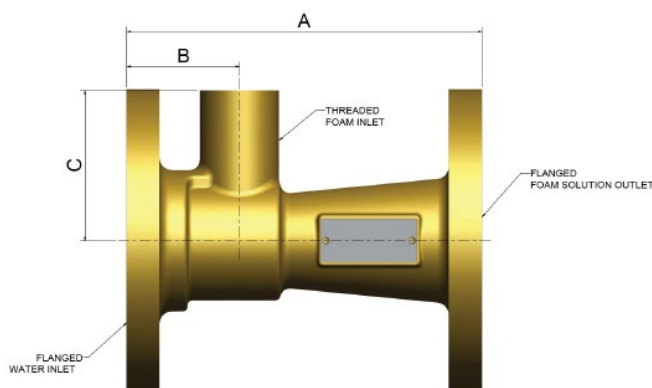


Figure 6.2.3 Model VRC Ratio Controller (Flanged)

Table 6.2.4 - Equivalent Length, Weight & Dimension Data

Nominal Size (Water Inlet/Foam Solution Outlet)	Equivalent Length (friction loss)*		Approximate Weight		Approximate Dimensions							
			NAB Version		A		B		C		Threaded Foam Inlet	
	Feet	Metre	LBS	KGs	Inch	mm	Inch	mm	Inch	mm	Inch	Type
3" PN16	31	9.45	27.2	12.3	9-1/4	235	2-15/16	79	3-15/16	100	1.5	BSP
3" ANSI	31	9.45	27.4	12.4	9-1/4	235	2-15/16	79	3-15/16	100	1.5	NPT
4" PN16	37	11.28	36.7	16.6	11	279	3-5/16	84	4-3/8	111	2	BSP
4" ANSI	37	11.28	37.1	16.8	11	279	3-5/16	84	4-3/8	111	2	NPT
6" PN16	88	26.82	62.7	28.4	15	381	3-5/16	84	5-7/16	138	2	BSP
6" ANSI	88	26.82	63.2	28.6	15	381	3-5/16	84	5-7/16	138	2	NPT
8" PN16	114	34.75	98.9	44.8	16-3/4	426	3-11/16	94	6-11/16	170	2.5	BSP
8" ANSI	114	34.75	99.6	45.1	16-3/4	426	3-11/16	94	6-11/16	170	2.5	NPT

* Expressed in equivalent length of schedule 40 pipe based on Hazen & Williams C=120




TECHNICAL DATA

FOAM RATIO CONTROLLER MODEL VRC

The Viking Corporation, 210 N Industrial Park Drive, Hastings MI 49058
 Telephone: 269-945-9501 Technical Services: 877-384-5464 Fax: 269-818-1680 Email: techsvcs@vikingcorp.com
 Visit the Viking website for the latest edition of this technical data page www.vikinggroupinc.com

7. PERFORMANCE DATA

7.1 Friction Loss vs Foam Solution Flow

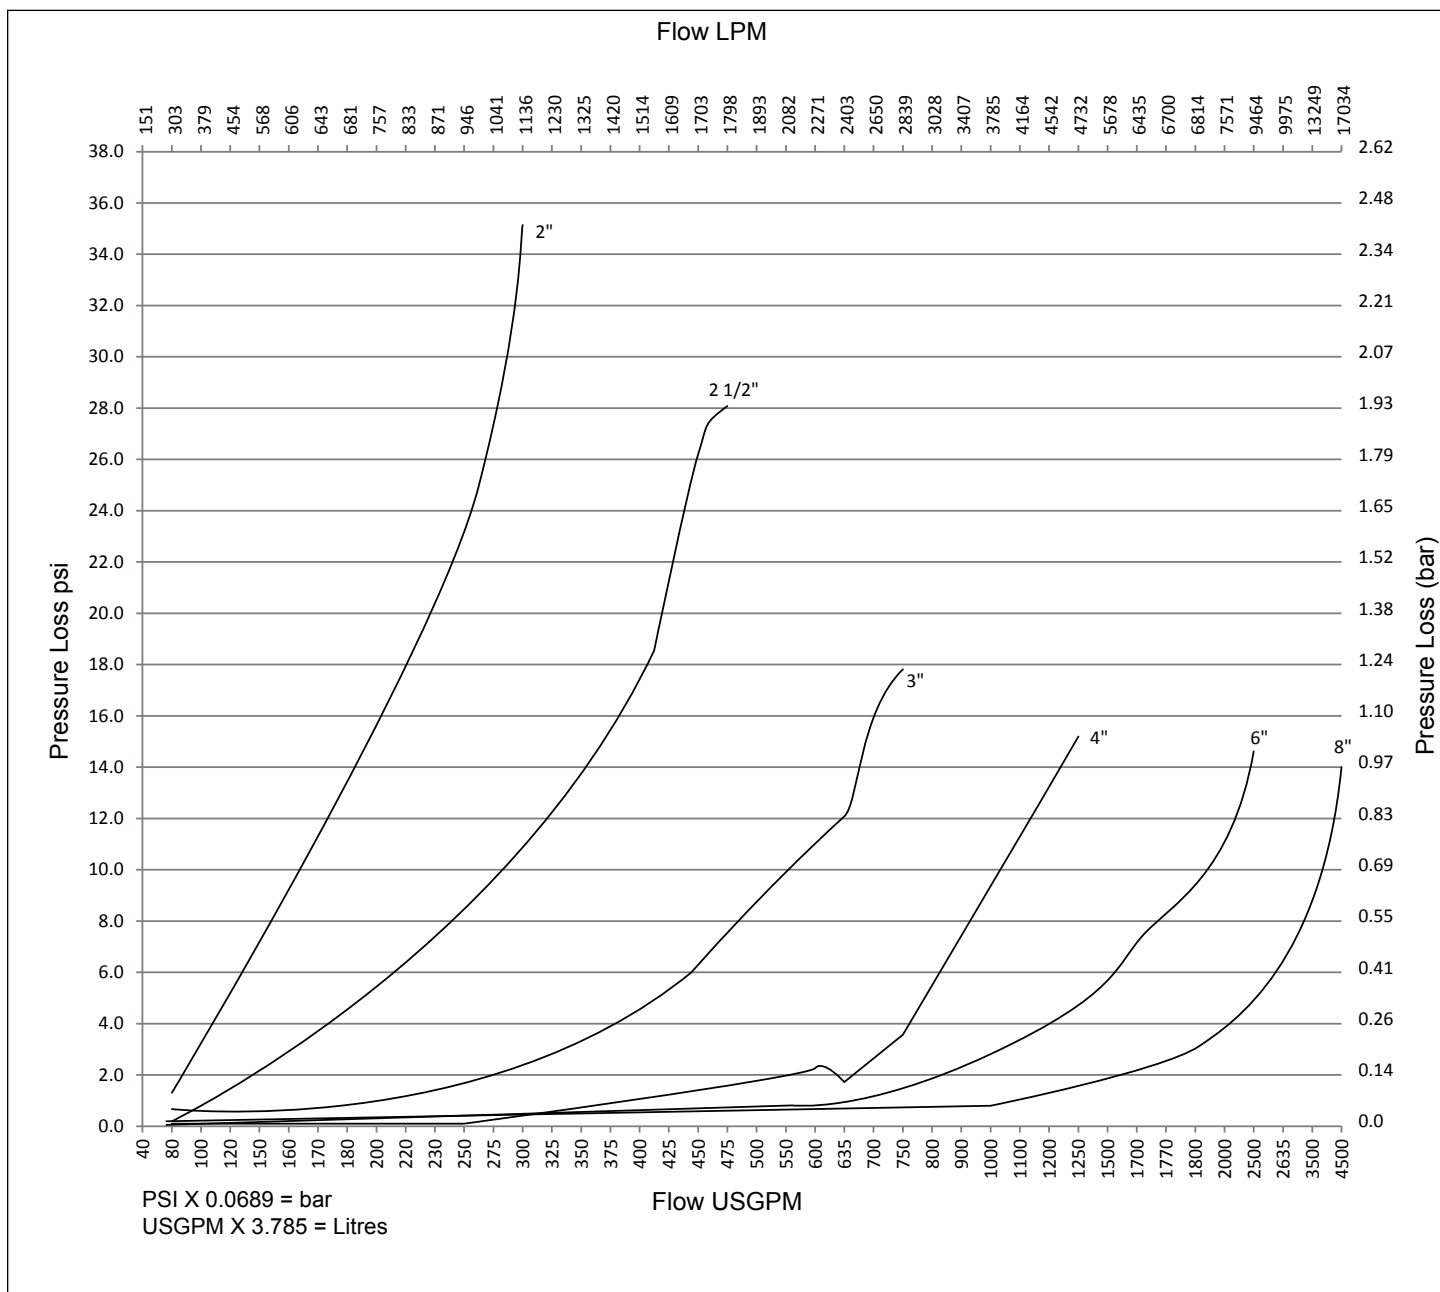

Graph 7.1.1
Friction Loss vs Foam Solution Flow




TECHNICAL DATA

FOAM RATIO CONTROLLER MODEL VRC

The Viking Corporation, 210 N Industrial Park Drive, Hastings MI 49058
 Telephone: 269-945-9501 Technical Services: 877-384-5464 Fax: 269-818-1680 Email: techsvcs@vikingcorp.com
 Visit the Viking website for the latest edition of this technical data page www.vikinggroupinc.com

7.2 Inlet Pressure vs Foam Solution Flow

Ratio Controller must be used within the shaded flow and pressure conditions

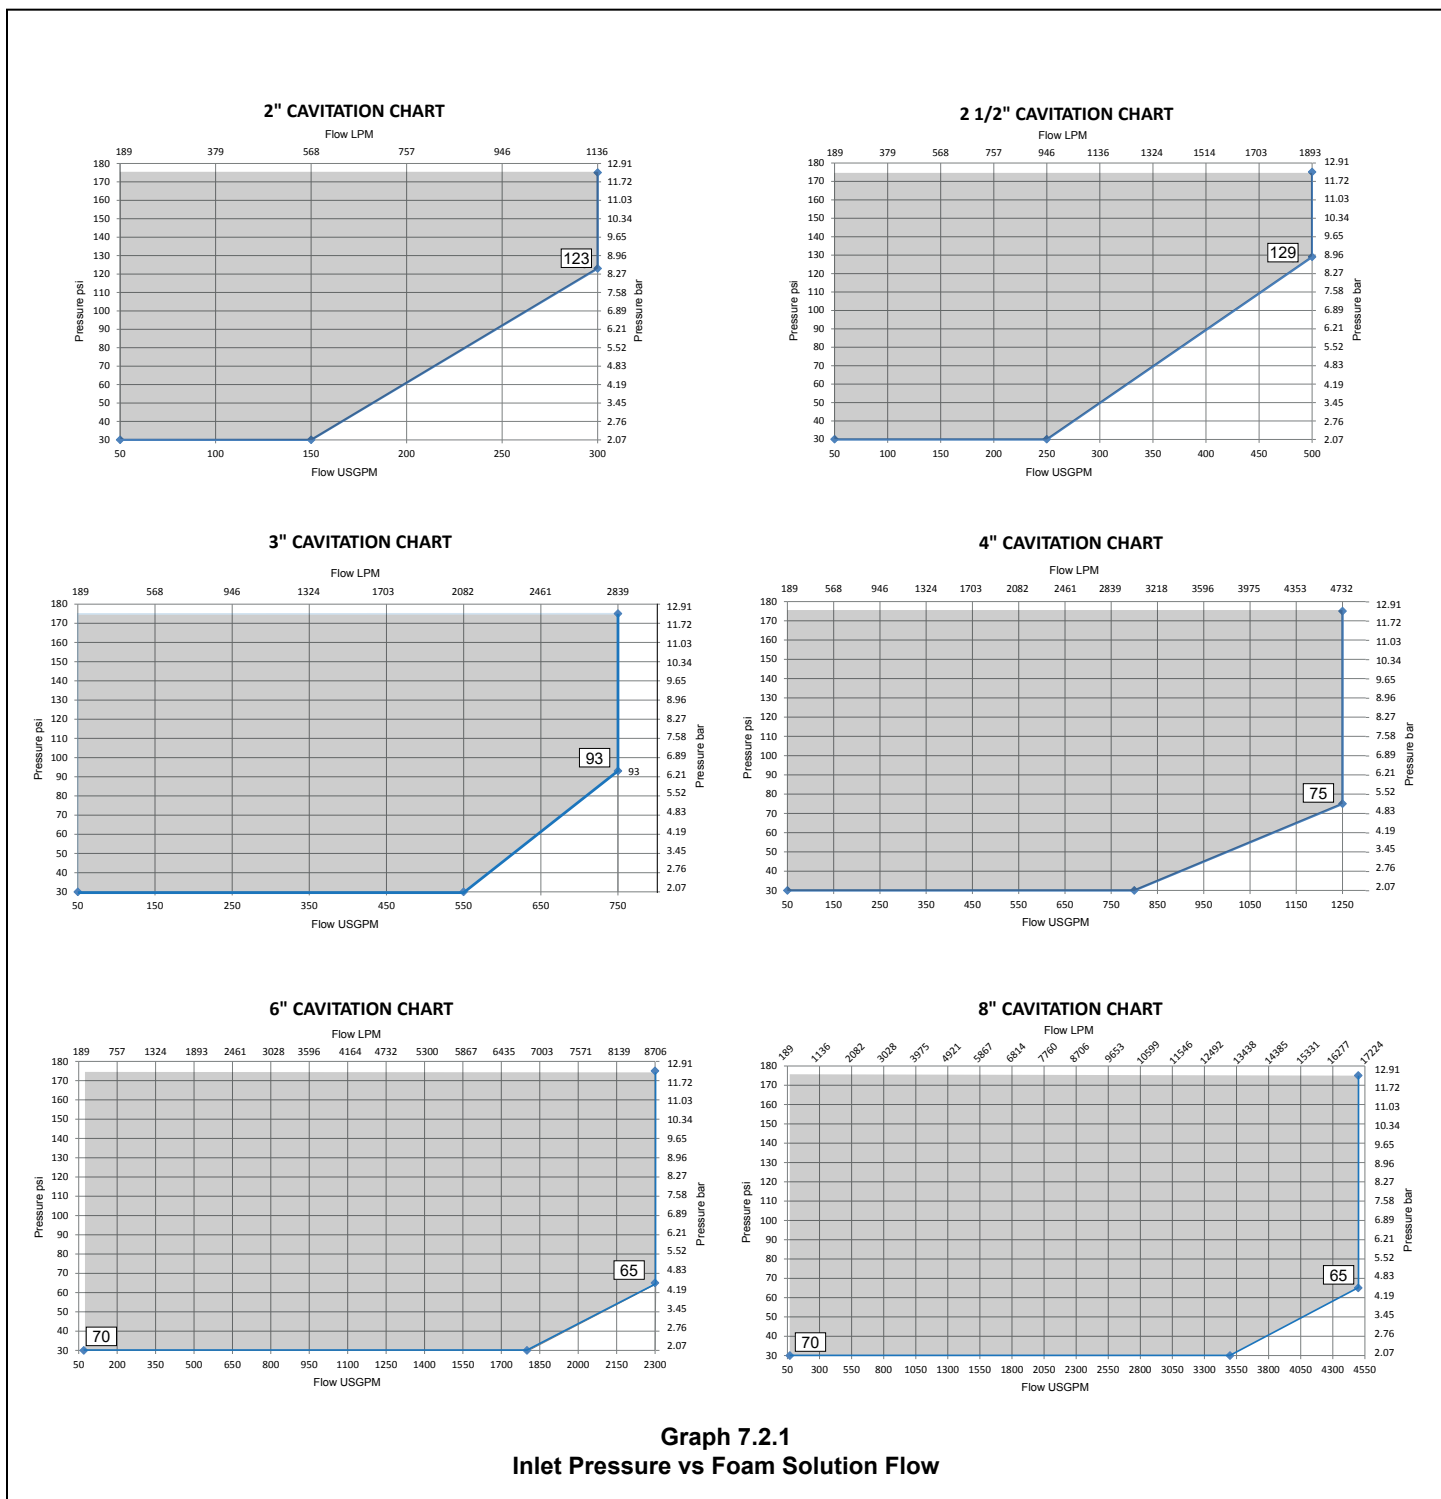

Graph 7.2.1
Inlet Pressure vs Foam Solution Flow



TECHNICAL DATA

FOAM RATIO CONTROLLER MODEL VRC

The Viking Corporation, 210 N Industrial Park Drive, Hastings MI 49058

Telephone: 269-945-9501 Technical Services: 877-384-5464 Fax: 269-818-1680 Email: techsvcs@vikingcorp.com

Visit the Viking website for the latest edition of this technical data page www.vikinggroupinc.com

8. INSTALLATION

Refer to appropriate Installation Standards (i.e. NFPA, VdS, LPCB, etc.) and / or applicable FM Global Property Loss Prevention Data Sheets such as 4-12, Foam-Water Sprinkler Systems. In addition, the "Authority Having Jurisdiction" (AHJ) may have additional installation requirements that must be followed.

Do not alter the piping without consulting a system design representative.

Before installing a ratio controller, check the system design drawing to ensure the controller location does not create excessive head pressure or frictional losses.

- a) The ratio controller must be installed with the arrow pointing in the direction of the water flow.
- b) The ratio controller can be installed in the vertical or horizontal position.
- c) Straight piping equal to a minimum of five (5) pipe diameters should be installed before and after the ratio controller to help ensure proportioning accuracy. This includes the proportioning test connection which is best installed further downstream after changes in pipe direction which helps to ensure a better mixing of foam solution.
- d) In Dry, Deluge and Preaction systems a removable section of pipe should be installed between the Concentrate Control Valve and Ratio Controller foam inlet to allow the flushing of foam concentrate after system activation.
- e) The ideal location for the controller is level or below the top discharge and within 3 feet (1m) of the tank. The controller can be placed further from the bladder tank, as long as the pressure of the foam concentrate at the foam inlet of the ratio controller is within 2PSI of the incoming water pressure at low flow rates.
- f) The pressure drop within the piping to the bladder tank water or foam concentrate piping can be minimized by:
 - 1) Limiting the number of tees and elbows used
 - 2) Using full port valves
 - 3) Increasing the pipe diameter
- g) The combined total equivalent length (pipe length plus equivalent lengths for fittings and valves) of the water supply inlet piping and the foam concentrate discharge piping should not exceed 50 equivalent feet (15.2m).
- h) The foam concentrate line should run as directly as possible from the bladder tank outlet to the ratio controller and avoid excessive changes in elevation.
- i) The diameter of this piping must be the same size or larger than the foam concentrate inlet into the ratio controller.
- j) Installation of a concentrate control valve (CCV) is highly recommended to prevent unintentional migration of foam from the bladder tank.
- k) Install a suitable check valve between the bladder tank and ratio controller to prevent system water flowing back to the bladder tank. This should be installed close to the ratio controller foam inlet connection.
- l) Care should be taken to ensure that the bladder tank and foam concentrate line are vented of trapped air to assist proportioning performance.

9. OPERATION

The ratio controller is a modified Venturi device. As water flows through the calibrated water nozzle, it creates an area of lower pressure, referred to as the metering pressure drop. As the water flow increases through the Venturi, the metering pressure drop increases, allowing more foam concentrate to enter through the sized foam orifice. A decrease in the water flow reduces the metering pressure drop, thereby reducing the foam concentrate flow.

Because the foam concentrate flow changes in direct proportion to the water flow, the ratio controller can accurately proportion foam concentrate over a wide range of water flow rates.

The flow rate at which the metering pressure drop is just high enough to overcome the pressure losses through the bladder tank and its piping, is called the low flow rating. The water flow rate through the ratio controller must be at or above its low flow rating in order to properly proportion foam concentrate.

10. GUARANTEE

For details of warranty, refer to Viking's current list price schedule or contact Viking directly.



TECHNICAL DATA

FOAM RATIO CONTROLLER MODEL VRC

The Viking Corporation, 210 N Industrial Park Drive, Hastings MI 49058

Telephone: 269-945-9501 Technical Services: 877-384-5464 Fax: 269-818-1680 Email: techsvcs@vikingcorp.com

Visit the Viking website for the latest edition of this technical data page www.vikinggroupinc.com

11. INSPECTION, TESTS AND MAINTENANCE

Refer to respective requirements, according to the relevant standards for Inspection, Testing and Maintenance.

If applicable, refer to FM Global Property Loss Prevention Datasheet 4-12 for specific test and commissioning criteria.

In addition, the "Authority Having Jurisdiction" (AHJ) may have additional maintenance, testing and inspection requirements that must be followed.

⚠ WARNING

Any system maintenance or testing that involves placing a control valve or detection system out of service may eliminate the fire protection capabilities of that system. Prior to proceeding, notify all Authorities Having Jurisdiction. Consideration should be given to employment of a fire patrol in the affected area.

12. DISPOSAL



At end of use the product described here should be disposed of via the national recycling system.

13. ACCESSORIES AND SPARE PARTS

None.

14. DECLARATION OF CONFORMITY

If required, Contact the appropriate Viking sales office in **Section 5 Availability** for further assistance.